
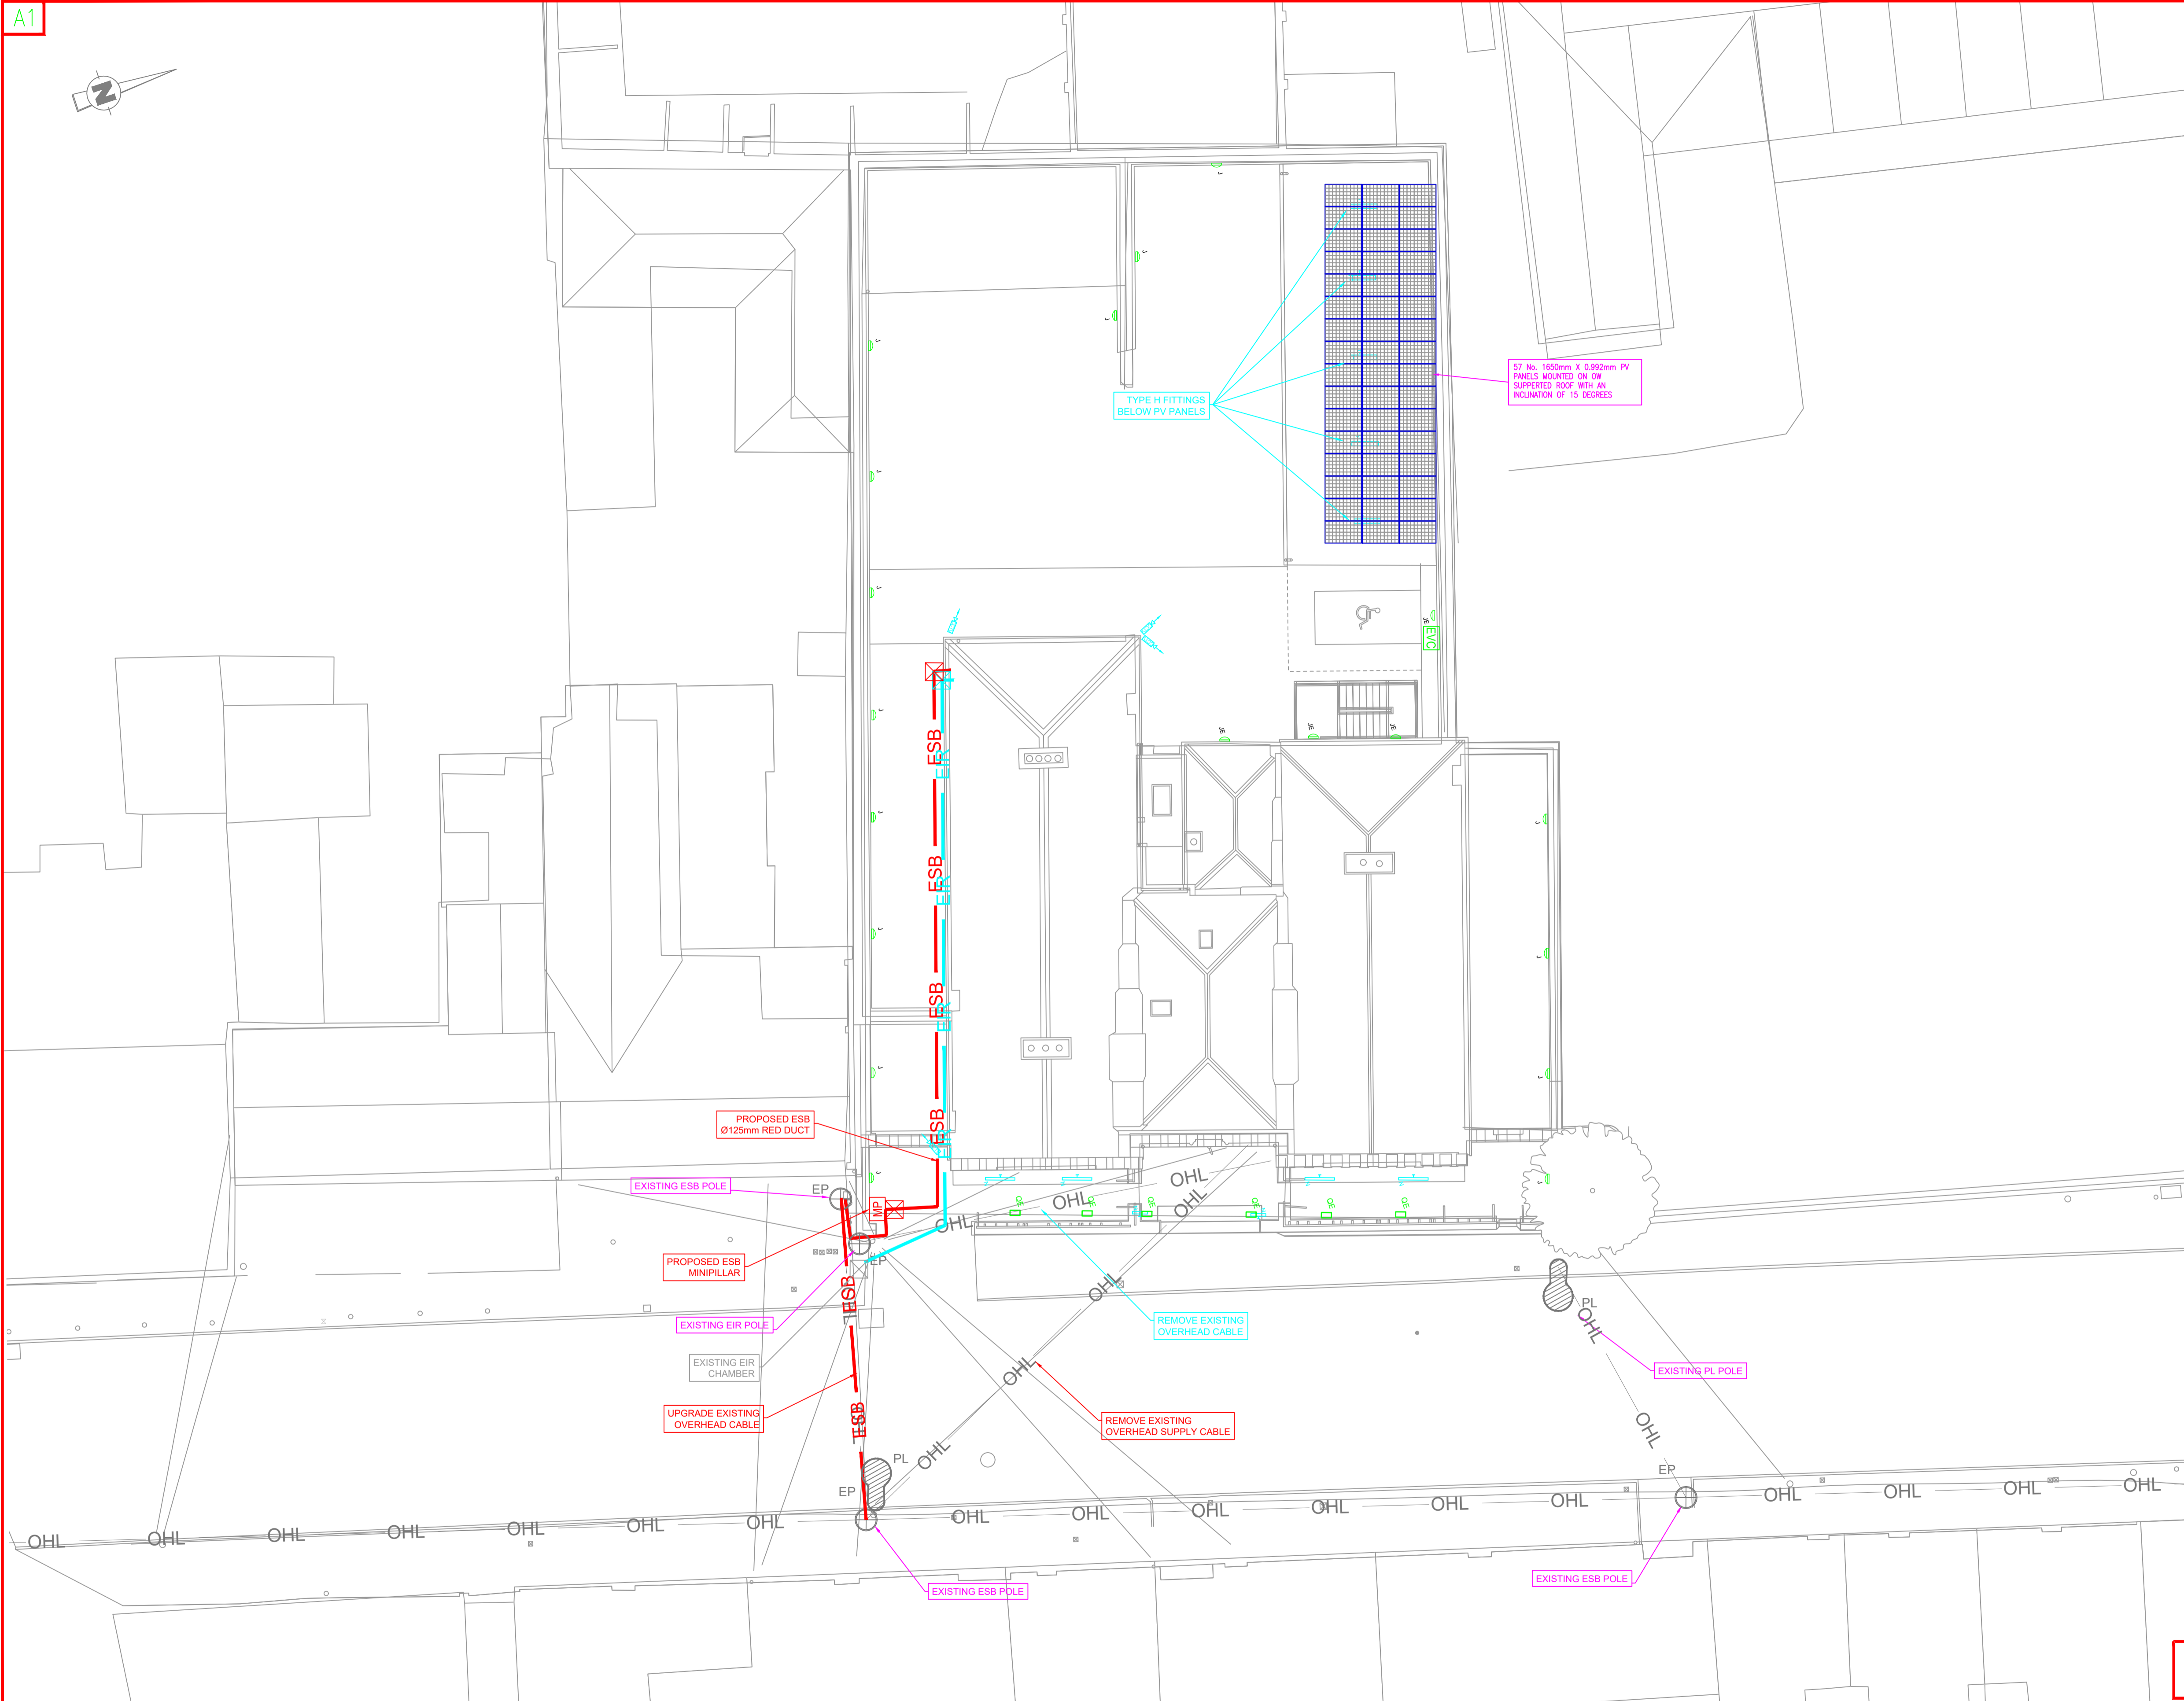
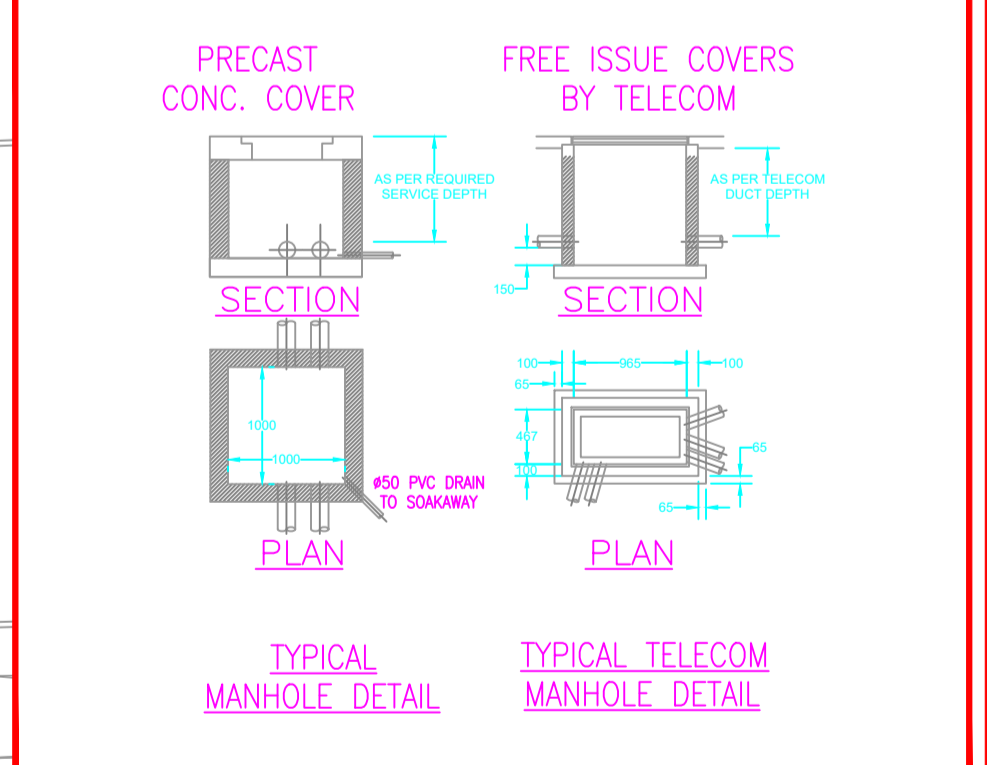
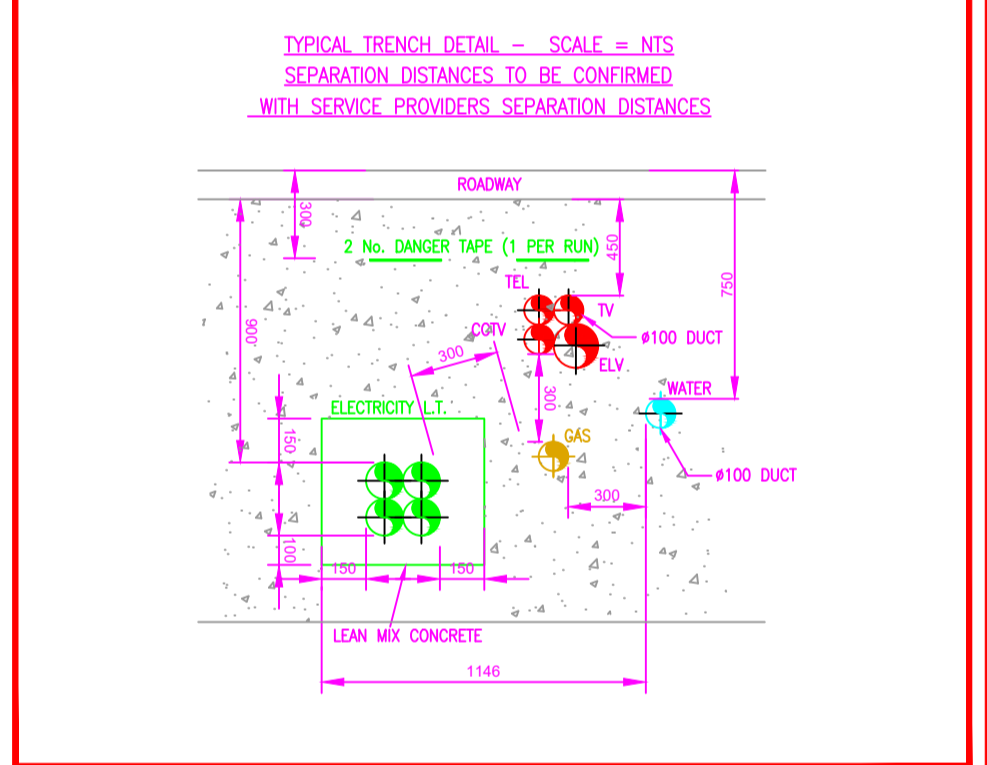


LEGEND:

- EXTERNAL LIGHTING DUCT #100mm RED
- ▭ IP65 CORROSION PROOF LINEAR
- ▭ EXTERIOR WALL MOUNTED RGB LINEAR
- ▭ EXTERIOR LED BRICK LIGHT WITH EMERGENCY PACKAGE
- ▭ WALL MOUNTED LED 22W, 2700lm, 4000K, IP66, IK08
- ⊗ MANHOLE
- ELECTRICAL RED DUCT #100mm
- ESB RED DUCT #125mm
- EXISTING ESB OVERHEAD LINE
- EIR DUCT GREY #110mm
- ⊗ OUTDOOR 2MP BULLET CAMERA, IK10, IP67, DUAL CMOS SENSOR, MIN 0.001lux, 100m IR
- ⊗ DOUBLE EV CHARGER

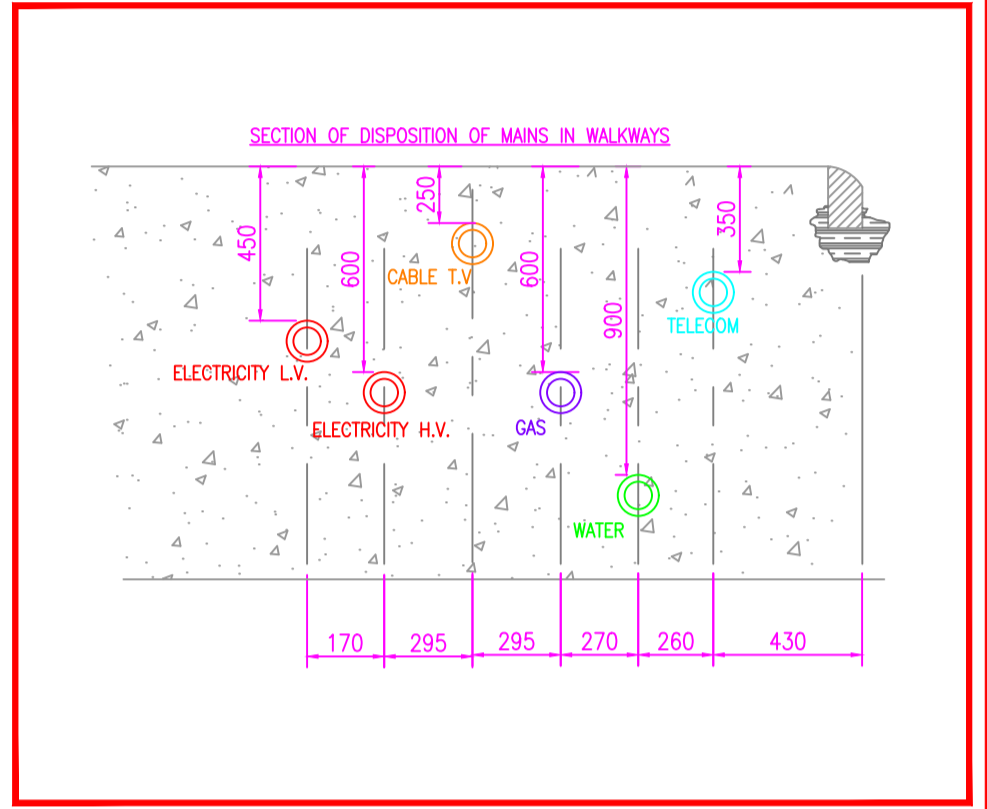

NOTES:

1. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, C&S ENGINEERS DRAWINGS & SPECIFICATIONS.
2. ALL WORKS TO BE CARRIED OUT IN ACCORDANCE WITH THE RELEVANT BUILDING REGULATIONS.
3. DO NOT SCALE — WORK TO FIGURE DIMENSIONS ONLY.

Referenced drawings

| Dwg No. | Dwg Title |
|---------|-----------|
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |

Issue register

| Rev. | Date | Description | Dwn. | Chkd. | Appvd. |
|------|----------|---------------------|------|-------|--------|
| P1 | 01/08/24 | ISSUED FOR PLANNING | JM | JM | PP |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |



PROPOSED SITE SERVICES LAYOUT

Date: 27/07/2024
Scale: 1:150@A1 (1:300@A3)

Drawn By: J.M.
Checked By: J.M.
Approved By: P.P.

Client: OFFALY COUNTY COUNCIL

Job Description: BIRR COURTHOUSE BIRR

Project No: 24ME011
Drawing Ref: ME-1000
Rev: P1

Hayes Higgins Partnership
Gas House Lane, Kilkenny

056 7764710 056 7732223
info@hayeshiggins.com

A.3.4 PLANNING